

NOTE 1 The hose does not pass through the solid partition or divider between the cupboards. A fixed metal bulkhead fitting with a hosetail (see figure 5) on each side passes through and is fixed to the partition. The hose from the cylinder is attached to the hosetail in the cupboard in which the cylinder is placed. The hose from the hob is attached to the hosetail in the cupboard space under the hob.

NOTE 2 If the worktop or cupboard installation is placed against an outside wall of the kitchen, a ventilation slot should also be placed in the outside wall at the bottom level of the cupboard.

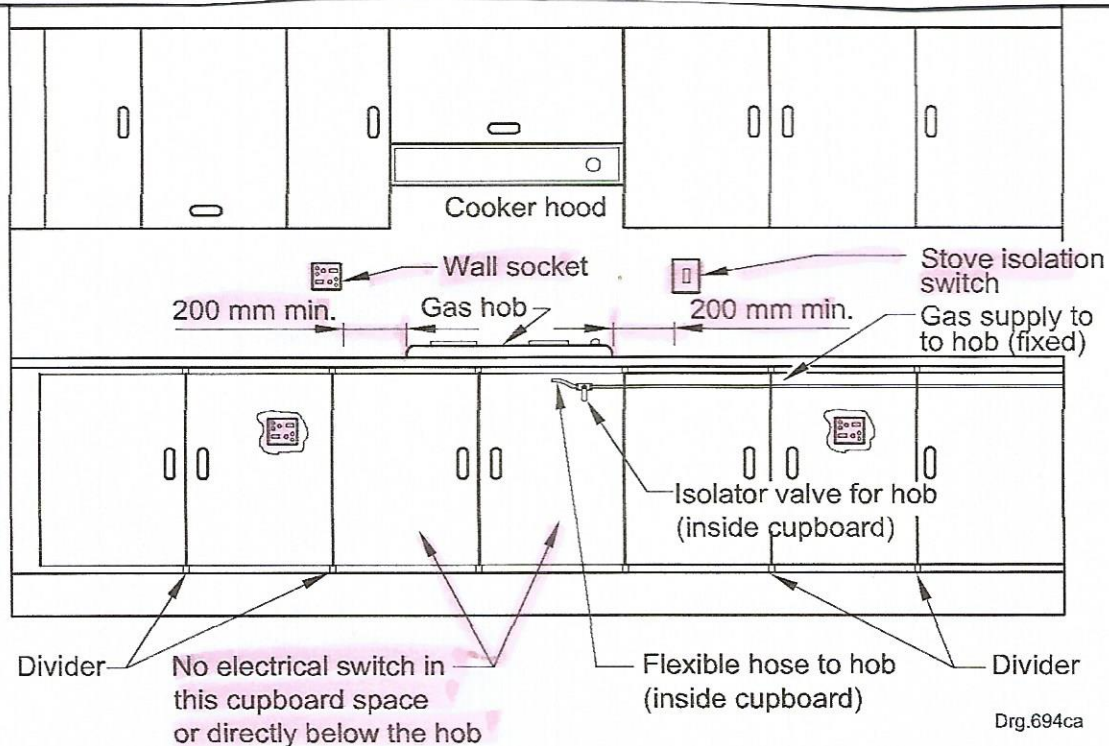


Figure 3 — Typical installation by means of a flexible hose and solid pipe